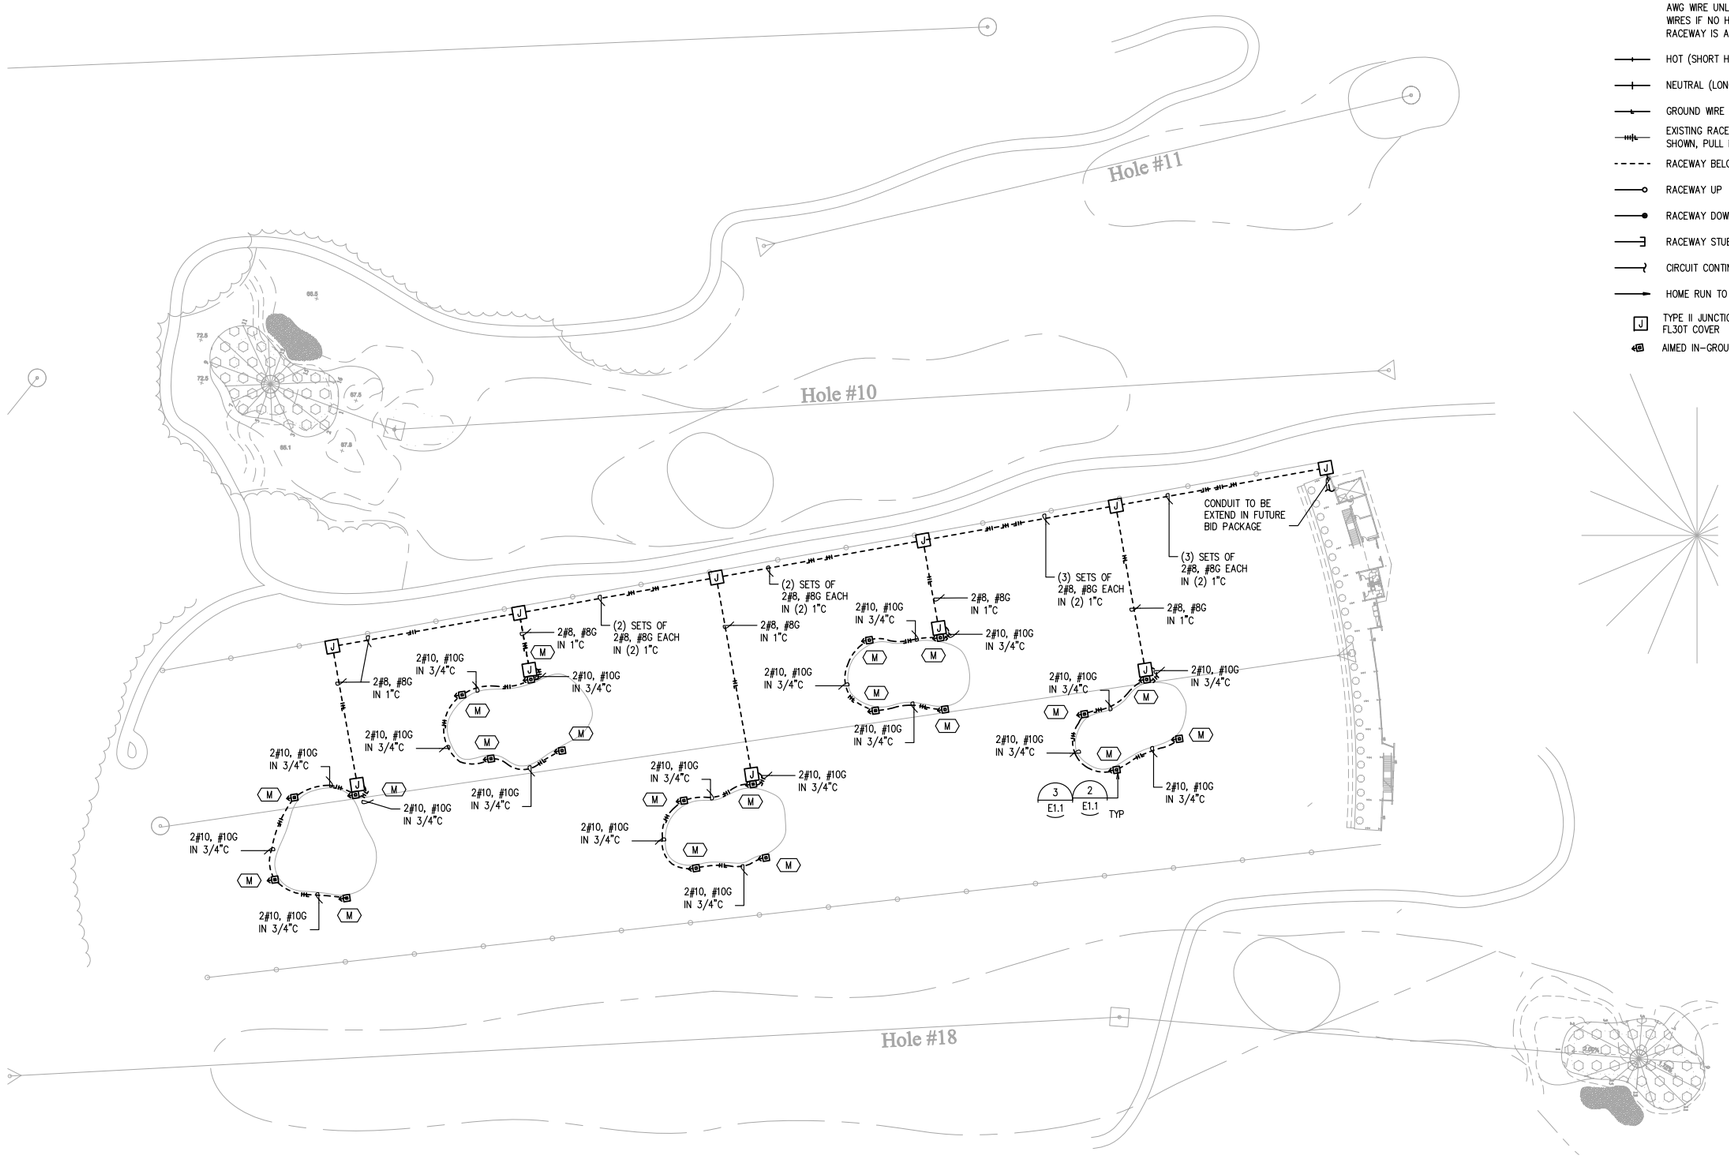

LEGEND

- RACEWAY CONCEALED IN CEILING OR WALL. HASH MARKS INDICATE NUMBER OF WIRES. #12 AWG WIRE UNLESS OTHERWISE NOTED. THREE WIRES IF NO HASH MARK SHOWN. EXPOSED RACEWAY IS ALLOWED ONLY WHERE NOTED.
- HOT (SHORT HASH MARK)
- NEUTRAL (LONG HASH MARK)
- GROUND WIRE (JOGGED HASH MARK)
- EXISTING RACEWAY (IF HASH MARKS ARE SHOWN, PULL NEW CONDUCTORS)
- RACEWAY BELOW SLAB OR UNDERGROUND
- RACEWAY UP
- RACEWAY DOWN
- RACEWAY STUB-OUT WITH BUSHING
- CIRCUIT CONTINUATION
- HOME RUN TO PANEL OR LOCATION NOTED
- J — TYPE II JUNCTION BOX, CHRISTY #FL30 WITH FL30T COVER
- AIMED IN-GROUND FIXTURE

GENERAL NOTES:

1. CALL 2 DAYS BEFORE YOU DIG AT 1-800-424-5555 TO HAVE ALL UTILITY LINES LOCATED. IT IS CONTRACTOR'S RESPONSIBILITY TO LOCATE EXISTING UTILITIES PRIOR TO COMMENCING WITH ANY EXCAVATION.



2 E1.1 **GREEN LIGHT TOP VIEW**
SCALE: AS INDICATED
0 4 8 16 24
1 inch plotted — Inches
If measurement is other than 1 inch then the plot is reduced.

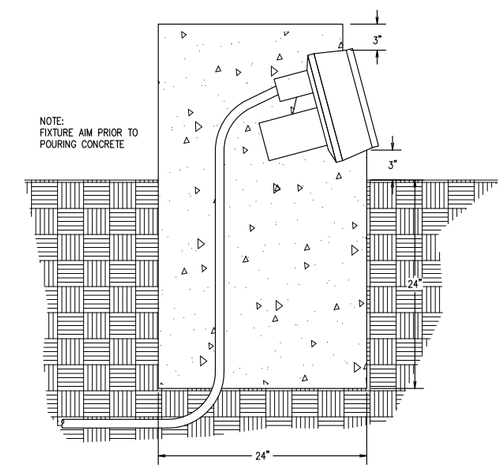

3 E1.1 **GREEN LIGHT SECTION VIEW**
SCALE: AS INDICATED
0 4 8 16 24
1 inch plotted — Inches
If measurement is other than 1 inch then the plot is reduced.

1 E1.1 **SITE PLAN - LIGHTING**
SCALE: AS INDICATED
0 25 50 100 150
1 inch plotted — Feet
If measurement is other than 1 inch then the plot is reduced.

LIGHTING FIXTURE SCHEDULE

TYPE	DESCRIPTION	WATTS	VOLTAGE
M	12" DIA WALL WASH. ONE-PIECE CAST WITH CLEAR TEMPERED BOROSILICATE GLASS LENS. ONE-PIECE HYDROFORMED REFLECTOR AND MEDIUM BASE SOCKET, 360° ROTATION AND SCREW LOCK. 1 HID LAMP, 100W. KIM LIGHTING LTV22 OR EQUAL	124	240

MARK D. PECKOVER — STATE OF WASHINGTON — 42253 — REGISTERED PROFESSIONAL ENGINEER

>>>>CAUTION - CALL 811<<<<
UTILITY NOTIFICATION CENTER BEFORE YOU DIG!
WWW.CALLBEFOREYOUDIG.ORG

NOT LESS THAN **2** OR MORE THAN **10** BUSINESS DAYS PRIOR TO COMMENCING EXCAVATION OR DEMOLITION, SECURE THE SERVICES OF A COMMERCIAL UNDERGROUND UTILITIES LOCATOR SERVICE TO IDENTIFY BELOW-GROUND IMPROVEMENTS THAT MAY NOT BE INDICATED ON THE DRAWINGS. ADDITIONALLY, TO REQUEST ON-SITE UNDERGROUND UTILITY SYSTEMS LOCATES, CALL **SPR INSPECTION REQUEST LINE @ (206) 684-7034.** REFER TO SECTIONS 02100 & 02120 OF THE SPECIFICATIONS FOR INSTRUCTIONS FOR HOW TO PROCEED.

NO.	REVISION – AS BUILT	DATE
5		
4		
3		
2		
1		

REVIEWED BY: _____ PARK ENGINEER _____ DATE

All work shall be done in accordance with the City of Seattle Standard Plans and Specifications in effect on the date shown above, and supplemented by the Special Provisions.

SEATTLE PARKS AND RECREATION

SPARLING — WORK TOGETHER | STAND APART™
733 Oak Street, Suite 200
Portland, Oregon 97205-3710
503.273.1060 800.667.6610
www.sparling.com

TANGELA — PLANNERS | LANDSCAPE ARCHITECTS | ENGINEERS | BUILDERS — R.W. THORPE & ASSOCIATES, INC.

OB SPORTS

JACKSON PARK GOLF COURSE
REDEVELOPMENT PLAN
SITE PLAN - LIGHTING

DESIGNED _____
DRAWN _____
CHECKED _____
ORDINANCE NO. TBD
CONTRACT NO. TBD
SCALE AS INDICATED

DATE 5/16/12
SHEET 1 OF ____
E1.1
PARK'S FILE NUMBER FOR PARK USE ONLY

N:\B17179\CADDR\E1-1 Jun 18, 2012 7:54 AM By:JLUO